




three eighths inch = one foot
one eighth inch = one foot
one quarter inch = one foot
one half inch = one foot
one inch = one foot
three quarters inch = one foot
one and one half inches = one foot
three inches = one foot

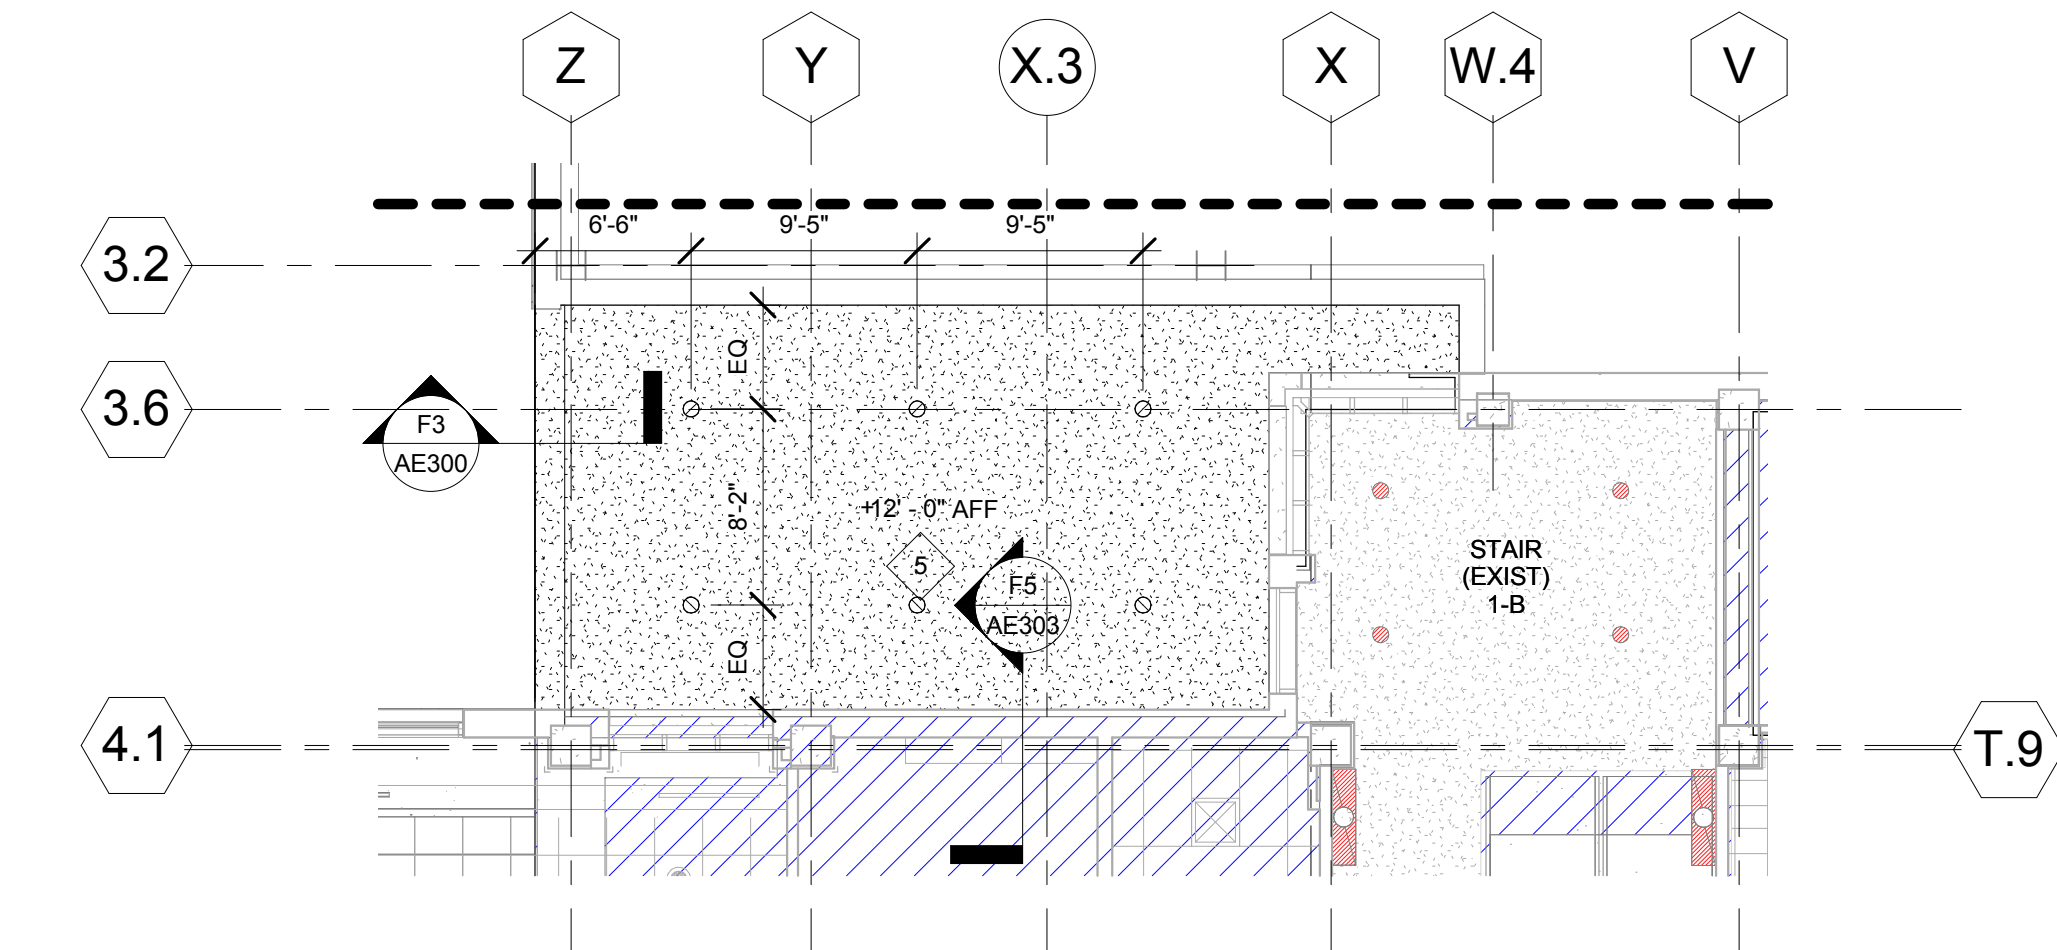

C1 PARTIAL FIRST FLOOR REFLECTED CEILING PLAN AT ENTRYWAY
1/8" = 1'-0"

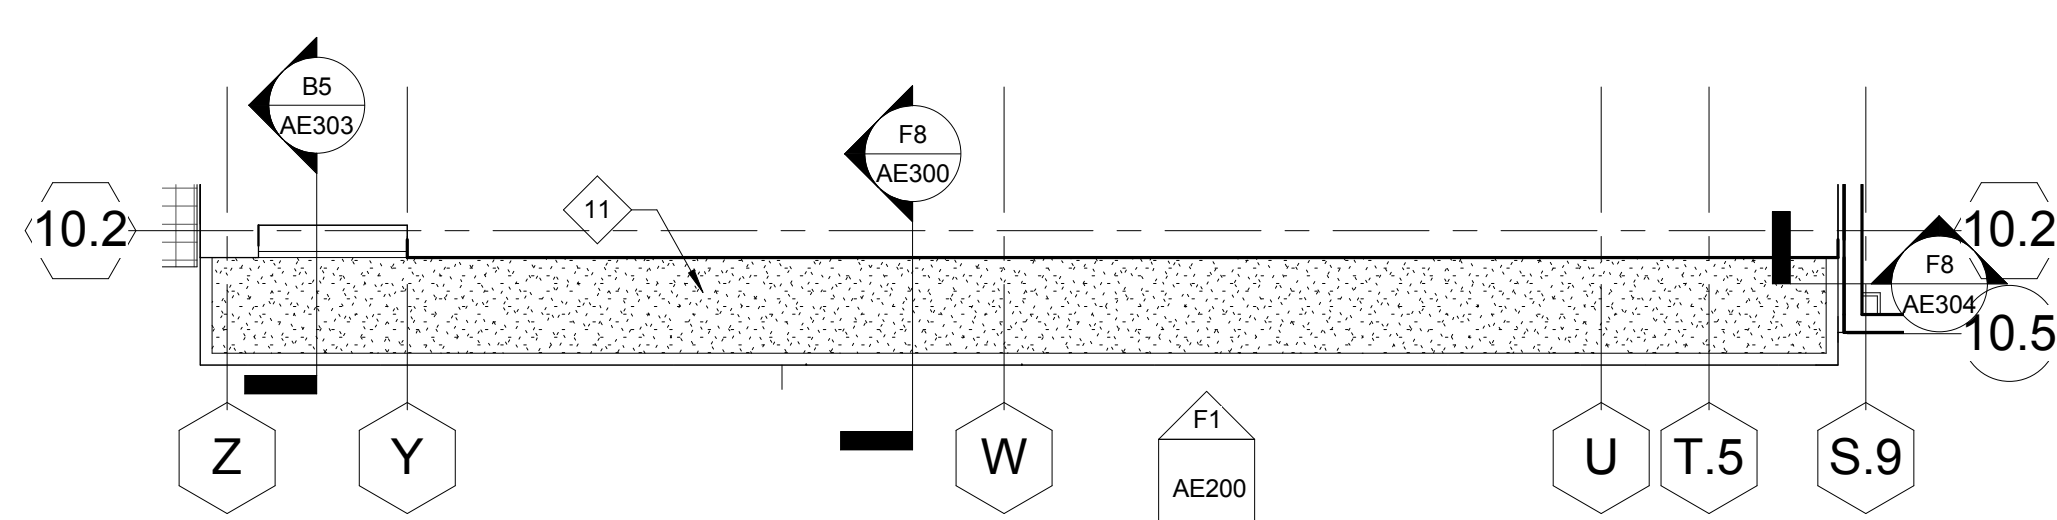

F1 PARTIAL FIRST FLOOR REFLECTED CEILING PLAN AT INTERSTITIAL MECHANICAL LEVEL OVERHANG
3/32" = 1'-0"

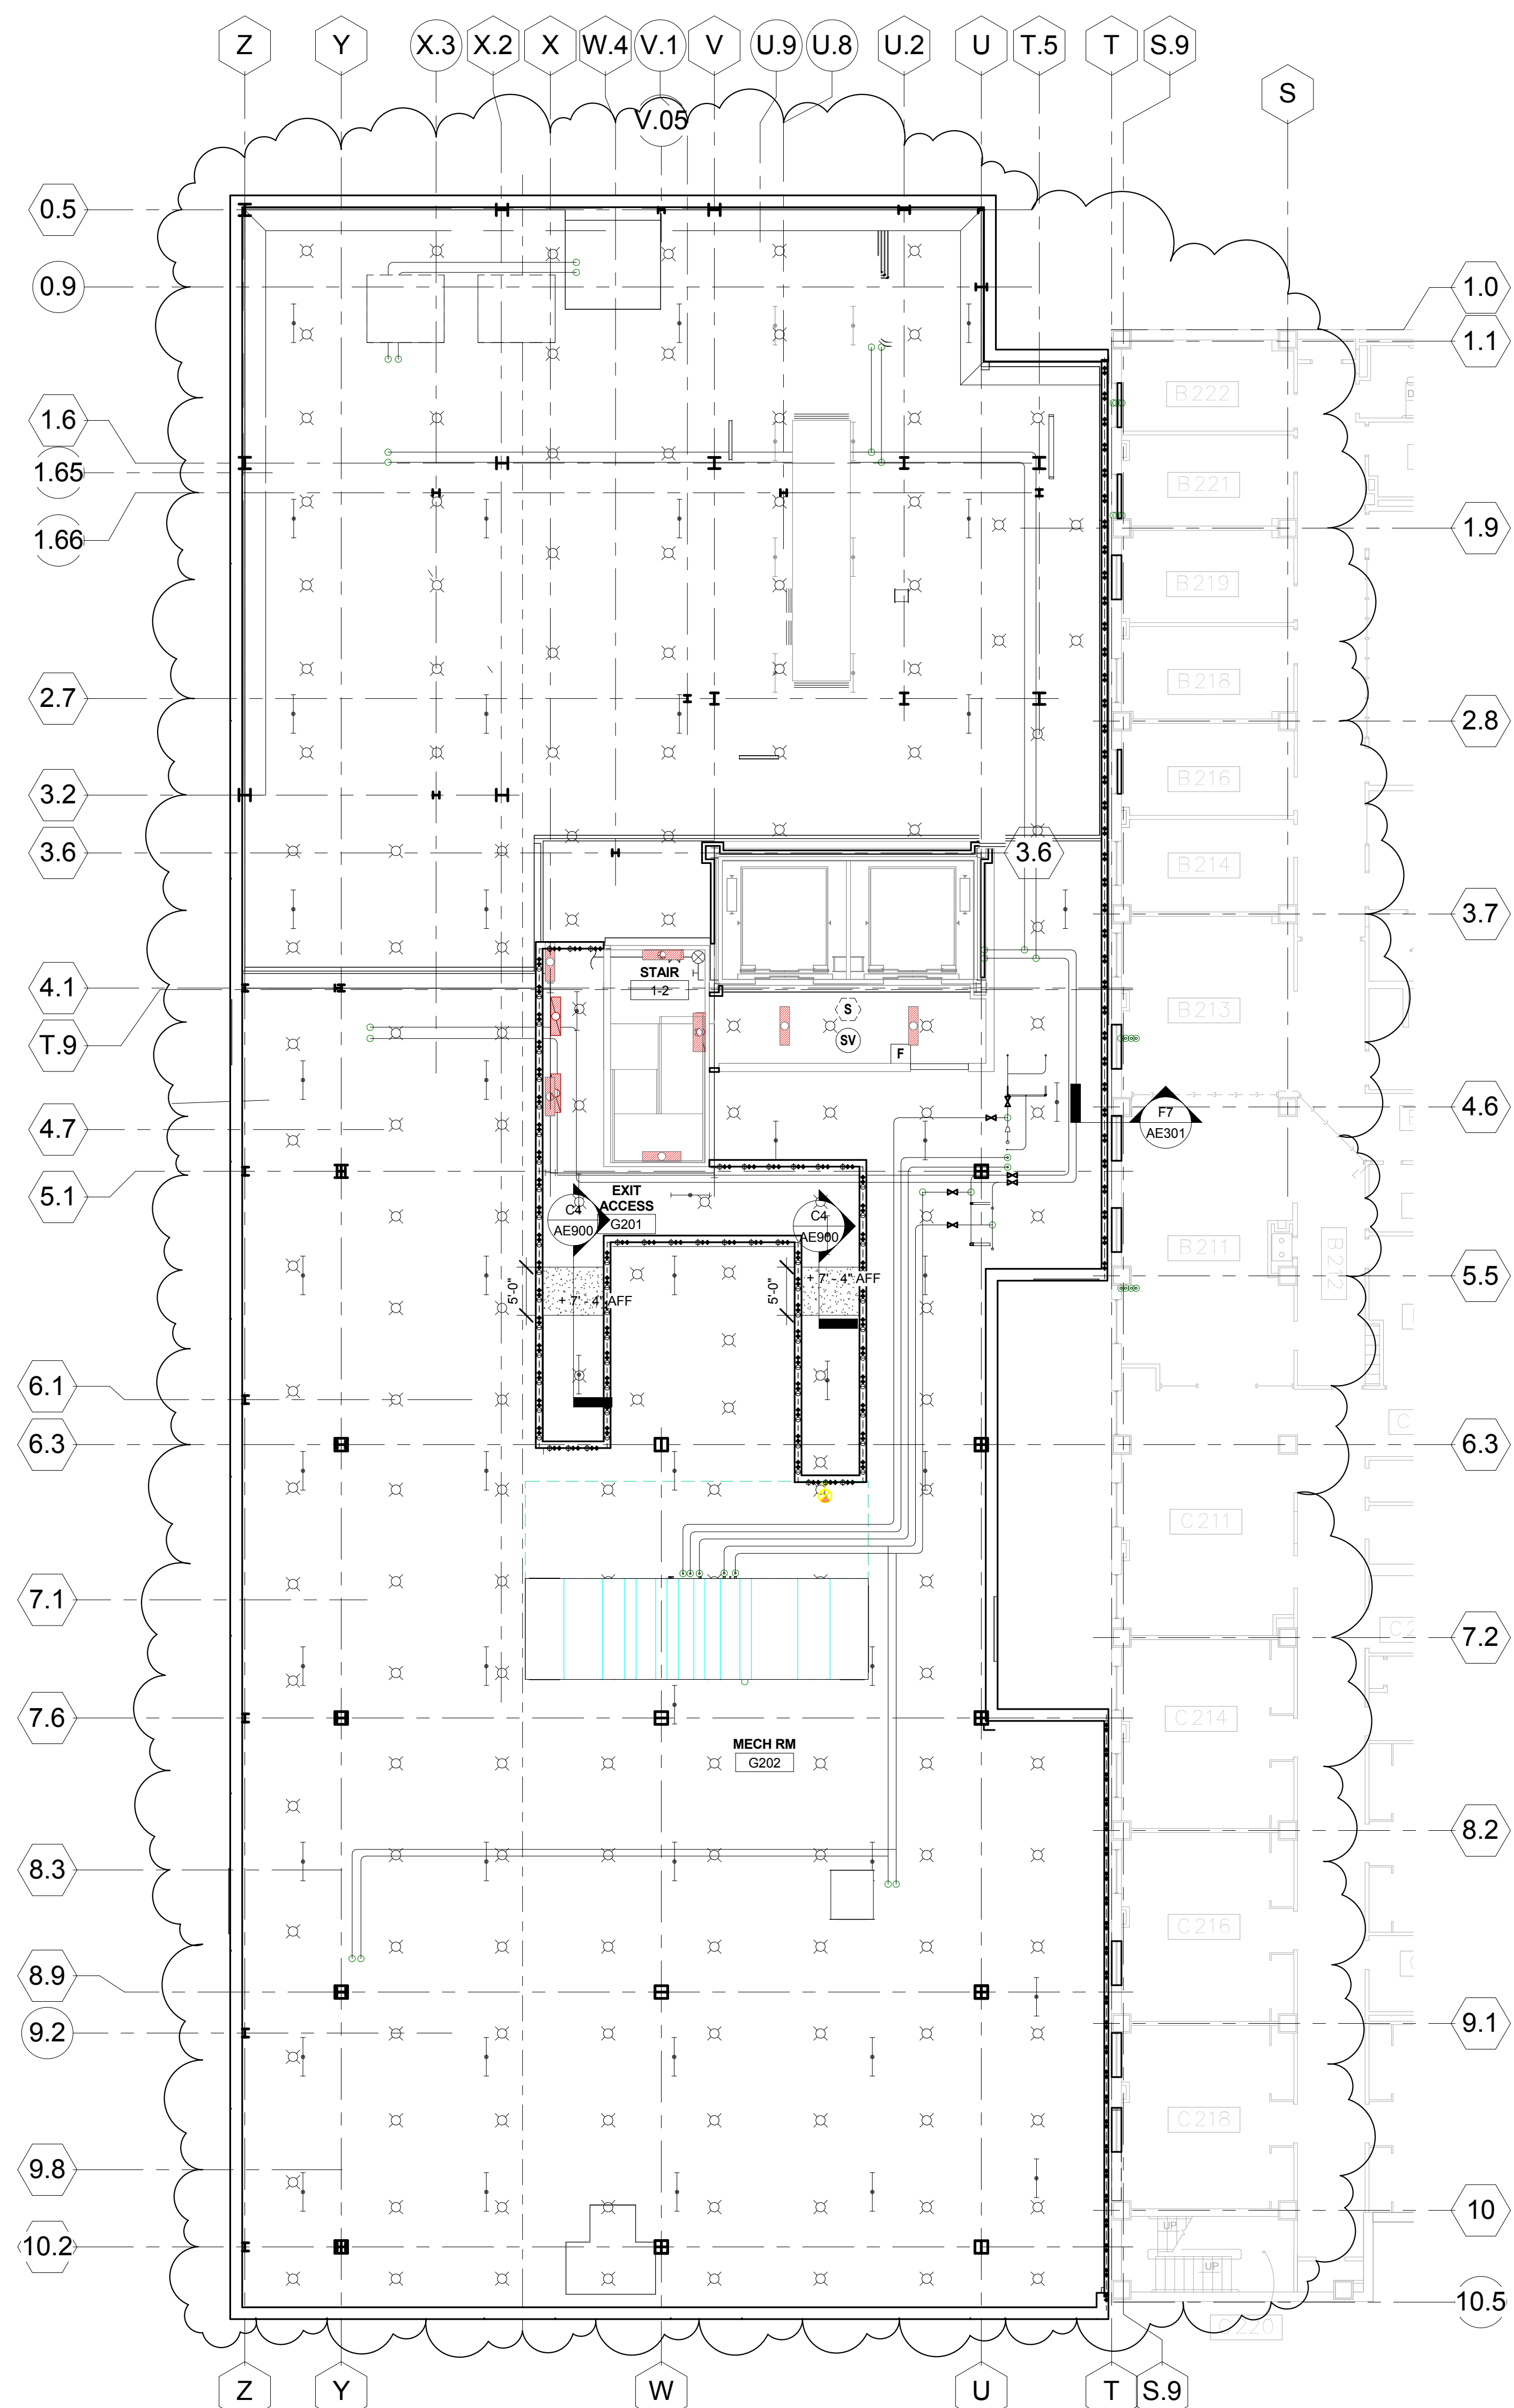

F3 INTERSTITIAL MECH. LEVEL REFLECTED CEILING PLAN
3/32" = 1'-0"

REFLECTED CEILING PLAN AND MEPPF SYMBOL LEGEND

- RECESSED DOWNLIGHT
- 2x6" WALL MOUNTED LIGHT FIXTURE - EMERGENCY POWER
- 1x4 RECESSED LIGHT FIXTURE - EMERGENCY POWER
- 2x4 RECESSED LIGHT FIXTURE - EMERGENCY POWER
- 1x4 RECESSED LIGHT FIXTURE
- 2x4 RECESSED LIGHT FIXTURE
- 2x4 SUPPLY AIR DIFFUSER
- 2x2 SUPPLY AIR DIFFUSER
- SUPPLY AIR DIFFUSER
- 2x2 RETURN AIR/EXHAUST
- FLUSH MOUNTED PUBLIC ADDRESS VISUAL/ SPEAKER
- EXIT LIGHT
- OCCUPANCY SENSOR
- CEILING DOME CAMERA
- FIRE ALARM SPEAKER / VISUAL
- FIRE ALARM SPEAKER
- FIRE ALARM VISUAL
- SMOKE DETECTOR
- SPRINKLER HEAD
- SPRINKLER HEAD
- 2'x4' ACOUSTICAL CEILING PANELS AND GRID
- 2'x2' ACOUSTICAL CEILING PANELS AND GRID
- GYPSUM BOARD CEILING (UNO)
- CEILING MOUNTED EQUIPMENT SUPPORT BRACING (ABOVE CEILING) SUPPORT
- CEILING MOUNTED (CONCEALED) PROJECTION SCREEN
- PS1 - 116 BT
- HEIGHT
- WIDTH
- TYPE
- SYNCHRONIZED CLOCK SYSTEM
- POWER SUPPLY
- RADIANT CEILING PANEL
- CEILING MOUNTED PROJECTOR

REFLECTED CEILING PLAN GENERAL NOTES

- CEILING HEIGHTS ARE 9'-0" AFF UNO
- NOT ALL KEYED NOTES USED THIS SHEET
- ALL DIMENSIONS FOR PATIENT LIFT TRACK SHALL BE COORDINATED WITH SELECTED MANUFACTURER'S REQUIREMENTS AND MAY VARY
- CEILING HEIGHT IN PATIENT TOILETS MAY VARY BASED ON PATIENT LIFT MANUFACTURER SELECTED. CONTRACTOR SHALL COORDINATE REQUIRED HEIGHT WITH SELECTED LIFT SYSTEM MANUFACTURER'S RAIL MOUNTING REQUIREMENTS

REFLECTED CEILING PLAN KEYED NOTES

- CEILING SYSTEM GRID LINE
- CEILING RECESSED RAILS WITH TRAVERSE RAIL FOR ROOM COVERING PATIENT LIFT SYSTEM, WITH TRANSFER TO SINGLE TRACK PATIENT LIFT WITH (1) 30 DEGREE BEND AND (1) 60 DEGREE BEND, COMPATIBLE WITH EXISTING GULDMANN LIFTS, TYP ALL PATIENT ROOMS
- CUBICLE CURTAIN TRACK, TYP ALL PATIENT ROOMS
- EXPANSION JOINT
- VERIFY HEIGHT OF SOFFIT WITH EXISTING CONDITIONS AS REPRESENTED IN F3/AE300
- ALIGN
- TIE INTO EXISTING CEILING GRID, PATCH/MATCH EXISTING
- REWORK EXISTING CEILING GRID AND CEILING PANELS AS DISTURBED BY PARTITION DEMOLITION, REPLACE CEILING PANELS WHERE DAMAGED, TO MATCH EXISTING
- LIGHT COVE, SEE DETAIL
- LINEAR LIGHT FIXTURE RECESSED IN CEILING. SEE ELECTRICAL
- EIFS SOFFIT

FULLY SPRINKLERED
CONSTRUCTION DOCUMENTS

CONSULTANTS: STRUCTURAL ENGINEER: KPFF CONSULTING ENGINEERS - ST. LOUIS 1630 DES PERES RD, SUITE 100 SAINT LOUIS, MO 63131 MECHANICAL/ELECTRICAL: KRW ENGINEERING CONSULTANTS - ST. LOUIS #15 SUNNEN DRIVE, SUITE 104 ST. LOUIS, MO 63141 PLUMBING: 303RD ENGINEERING GROUP, LLC 1935 ARSENAL STREET ST. LOUIS, MO 63118 ESTIMATING: KYWANE BUILDING GROUP 1204 WASHINGTON AVE. SUITE 200 ST. LOUIS, MO 63103 LIFE SAFETY/FIRE PROTECTION: CODE CONSULTANTS, INC. 2043 WOODLAND PARKWAY, SUITE 300 ST. LOUIS, MO 63146 ACOUSTICAL ENGINEERS: ACUSTICCONTROL, LLC 1709 WASHINGTON AVENUE, LOFT 300 ST. LOUIS, MO 63103 COMMISSIONING: ZODIAC INTERNATIONAL 16100 CHESTERFIELD PARKWAY, SUITE 365 CHESTERFIELD, MO 63017 ENVIRONMENTAL: ENVIRONMENTAL CONSULTANTS, LLC #6 MEADOW HEIGHTS PROFESSIONAL PARK DR COLLINGSVILLE, IL 62224			ARCHITECT/ENGINEERS: CHRISTNER ARCHITECTS DESIGNERS PLANNERS LANDSCAPE ARCHITECTS 168 N MERAMEC, SUITE 400 ST. LOUIS, MISSOURI 63105 TEL 314 725 2927 FAX 314 725 2928 CHRISTNERINC.COM			Drawing Title INTERSTITIAL MECHANICAL LEVEL AND PARTIAL FIRST FLOOR REFLECTED CEILING PLAN DIRECTOR OF SPECIALTY CARE INJECTION CONTROL FUNCTION CHIEF ENGINEER ASSISTANT DIRECTOR ASSOCIATE DIRECTOR OF PATIENT SERVICES CHIEF OF STAFF ASSOCIATE DIRECTOR MEDICAL CENTER DIRECTOR			Project Title INTENSIVE CARE UNIT Location HARRY S. TRUMAN VAMC Date 12/30/13 Checked jw Drawn ew Approved			Project Number 589-330 Building Number 1 Drawing Number AE412 Dwg. 37 of 296			Office of Construction and Facilities Management Department of Veterans Affairs		
1 2/9/15 Amendment #6 No. Date Revisions																	